



Government of Jammu and Kashmir (J&K)



OFFICE OF THE EXECUTIVE ENGINEER
JAL SHAKTI (PHE) MECHANICAL DIVISION SOUTH AWANTIPORA.
E-MAIL ID: xenphemechsouthawp@gmail.com Fax/phone. 01933-295537

Allotment Order No: 10 of 05/2023

M/S Srinagar Mechanical Works
Prop: Shamima Bashir
R/o: Wazirbagh, Srinagar.
Head Office: Wazirbagh, Srinagar
GST No: 01ALYPB5236A2ZK
Cell No: 9419013353

AA Accorded vide Order No.	SE/Hyd/Spn/81 Dated: 27/01/2021
Tech. Sanction Accorded vide Order No.	EE/JSD/Mech/ Awp/JJM/19 of 09/2022
Adv. Cost:	Rs. 20,86,000/-
Allotted Cost:	Rs. 20,81,000/-

Subject:- Supply, installation, testing and commissioning of electro-mechanical equipments at water supply scheme Zadipora of Jal Shakti (PHE) Mechanical Division South Awantipora under JJM.

Reference:- 1. This office e-NIT No.: 70 of 2022-23 of 16/11/2022 Issued under endorsement No.: JSD/PHE/MDSA/3692-3707 Dated: 16/11/2022.
2. Superintending Engineer Hydraulic Circle Shopian/Pulwama [HQ] Shopian (Member Secretary JJM) Office Letter No.: SE/Hyd/Spn/DB/251-64 Dated: 10-04-2023.
3. Acceptance of rates/extension of validity of your tender confirmed by you.

Dear Sir,

For and on behalf of Lt. Governor of J&K U.T contract for execution of aforementioned job is hereby fixed with you on item rate basis. This is in response to your online bid and subsequent acceptance of rates, specifications, terms and conditions as contained in Annexure "A & B" of this allotment order.

Encl. 10 lvs.

No.: MDSA/ 661-60.

Dated: 17 /05/2023

Yours Sincerely

Executive Engineer
Jal Shakti PHE Mechanical Division
(South) Awantipora
(Member JJM)

Copy to the:

1. Chief Engineer Jal Shakti (PHE) Department Srinagar for information.
2. District Development Commissioner (Chairman DJJM) Pulwama for information.
3. Superintending Engineer Jal Shakti (PHE) Mechanical Circle (South) Srinagar for information.
4. Superintending Engineer Jal Shakti (PHE) Hydraulic Circle Pulwama/Shopian for information.
5. Executive Engineer Jal Shakti (PHE) Division Awantipora for information.
6. Provisional Head, TPIA JJM Kashmir, (WAPCOS Limited) Corporate Office 76-C Institutional area Sector-18 Gurugram-122015 (Haryana) for information.
7. Assistant Executive Engineer Jal Shakti (PHE) Mech. Sub Division Pampore for information & necessary action. He will ensure execution of work strictly in accordance with the rates, specifications, terms / conditions & within the stipulated time, besides, the cost of work should not exceed beyond allotted cost. In case of any delay in completion of work, the reasons shall be justified.
8. File concerned.

ANNEXURE "A" to this office Allotment Order No: 10 of 05/2023

Name of work: Supply, installation, testing and commissioning of electro-mechanical equipments at water supply scheme Zadipora of Jal Shakti (PHE) Mechanical Division South Awantipora under JJM.

General Terms and Conditions: -

1. **TIME OF COMPLETION:** The scheme shall have to be completed/tested/commissioned within a period of **45 days** from the date of issue of this allotment order.
2. **AGREEMENT:** A formal agreement deed shall be executed by the firm with the department within a period of **07 days** from the date of issue of this allotment order after deposition of performance security @ 03% of allotted cost. However, non drawl of agreement will not prevent the contract from being enforced upon you.
3. **PENALTY:** In the event the contractor failing or delaying the work or a part thereof, & or non-complying with any of the terms and conditions of the contract, the NIT & the Agreement, the Department, without prejudice to the remedies available under the law in force in J&K UT, may terminate the contract after seven days' notice, and or recover the amount of loss caused by failure/delay or default of the contractor. The amount of such recoveries shall be determined by the Superintending Engineer PHE Mechanical Circle South Srinagar and or impose a penalty as the Government /Department may determine and or forfeit the performance security and or resort to any or all the remedial actions available under the law in force in the UT of J&K at the time of the dispute.
4. **ARBITRATION:** In case of any dispute arising at any stage between the contractor and the Department, the same shall be referred to the Superintending Engineer PHE Mechanical Circle South Srinagar /Govt. of J&K who may give a decision or nominate any other person of Government for arbitration, The decision to such arbitration shall be final and binding on both the parties.
5. **PERFORMANCE SECURITY DEPOSIT:** Soon after issuance of allotment order, the firm has to deposit performance security in the shape of CDR/FDR/BG valid for 18 months pledged to Executive Engineer PHE Mechanical Division (South) Awantipora within 07 days which shall be released after expiry of defect liability period/report of concerned AEE (After fulfillment of all contractual obligations). Failing to produce performance security, the firm is liable to be debarred for participation in future tendering in this Division and same shall be recommended to higher offices and other Govt. offices of UT of J&K.
6. **JURISDICTION OF COURT:** All disputes pertaining to this contract shall be subject to the jurisdiction of the Courts of J&K UT only.
7. **TERMINATION OF CONTRACT:** The department reserves the right to terminate the contract at any stage in case performance of the firm is found un-satisfactory in terms of any or all clauses of the NIT/Contract/Agreement in vogue.
8. **ADVANCE PAYMENT:** The Department shall in no case entertain any condition or request of making advance payment of any kind to the contractor during the execution of the work.
9. **TAXES, DUTIES LEVIES etc:-** The rates offered by the Department shall be firm and final. Payment of Income Tax/GST, Octroi, Toll tax, Entry tax, Cess service tax duties and other levies etc. of the central or the UT Government and incidental charges of any shall be the responsibility of the contractor/firm.
10. **FORCE MAJEURE CLAUSE:** Any failure or omission to carrying out the provision of the contract shall not give rise to any claim by the department or the contract one against the other if such failure or omission arises from the Act of God which shall include all natural calamities such as fire , floods , earthquakes, hurricane strikes, riots, embargoes from any political or other reasons beyond the control of parties including the war whether declared or not civil war or a state of insurrection.
11. **ENGAGEMENT OF LABOURS:** The contractor shall not engage any workman below the age of 18 years. Firm/Contractor shall also comply with the provisions of labour laws and rules framed thereof and as prevalent in the UT of J&K. The contractor shall be responsible for any accident to the human life which may occur during the execution of work, compensation as shall be provided under law or any law will be payable by the contractor.
12. **INSURANCE:** The contractor shall insure all work-man at his own cost till the completion of work and take over by the department.
13. **DEFECT LIABILITY PERIOD:-** The defect Liability period shall be for a period of **12 Months** which shall commence after the successful completion of Trial run, during the defects Liability period (DLP) the firm shall have to operate & maintain the scheme as it is required for its successful running & as per Standard Engineering Practices, to the full satisfaction of the department. The bidder shall be responsible to make good & remedy at

(Contd. On page...2nd...)

Executive Engineer


ANNEXURE "A" to this office Allotment Order No: /0 of 05/2023

his own expense any defect in works which is noticed during the DLP. In case any defect remains unattended by the firm at the completion of DLP, the department may extend the DLP for such time as deemed fit for getting the defect rectified subject to a maximum ceiling of 6 Months.

- 14. TRANSIT INSURANCE:-** Prior to dispatch, the ordered equipment shall be insured through a Nationalized Insurance Company up to its final destination, against all transit risks. The firm should, therefore, take appropriate insurance policy in advance for covering the transit of the goods, charges for which shall be borne by the tenderer and shall be included in his quoted rates. The department shall pay no extra charges on this account.
- 15. SUBLETTING OF WORK:-** The bidder shall not sublet the whole or part of the work. The bidder shall not assign the work or any part thereof or any benefit or any interest thereon or any claim arising of the contract, without prior written consent of the allotting authority.
- 16. LIQUIDATED DAMAGES (LD):-** In the event of firm's/joint venture failing, declining, neglecting or delaying the supplies / works or in the event of any damage occurring or being caused by the firm/ joint venture or in the event of any default or failure by the firm in complying with any of the terms and conditions of the contract, the Department shall with or without prejudice to any other remedies available to it under any law for the time being enforce in the UT:
- a) Terminate the contract after 15 days' notice
and/or
 - b) Recover the amount of loss caused by damage, failure or default, as may be determined by the department.
and/or
 - c) Recover the extra cost, if any, involved in allotting contract to other party.
and/or
 - d) Impose Liquidated damages on account of delay beyond the schedule completion period to the tune of 0.5% of the delayed portion of contract every week but not exceeding 10% value of the contract,
and/or
 - e) Forfeit the performance security and blacklist the firm.
- 17. THIRD PARTY MONITORING:** The allotted works shall be subject to check by the third party monitoring agency appointed by the Department in Kashmir. The agency shall check the quality of works executed by the agencies, quality of materials used for construction and quality of machinery installed in each scheme. The TPIQM's role shall be that of an assistant to the Employer's Representative for the purpose of monitoring and evaluation of the performance of the Contract during the Contract Period.
- 18. STORAGE AT SITE:** The bidder shall at his own cost make arrangements for proper storage especially towards Rain and Snow damages of the equipment/ materials at sites till its erection/completion. For the purpose the bidder shall, with the approval of Engineer in charge construct temporary storage accommodation for equipment/ material at site for which land shall be provided by the department near the site of work.
- 19. OPERATION AND MAINTENANCE MANUALS:** The bidder shall supply, free of cost to the Department, six complete sets of operation and maintenance manuals for the Pumping Equipment. The delivery of these manuals shall be made by the bidder to the Engineer along with the supply of equipment. The manuals shall be appropriately bound in book form and shall contain all necessary instructions regarding operation, preventive maintenance, repairs, trouble shooting, overhauling etc,
- 20. OEM Certificate:** The contractor shall produce all relevant test certificates of the manufacturer to the Engineer in-charge before start of the work. The test certificates of the equipment's on whole or all accessories/ attachments and mountings thereof shall be appended with the invoice at the time of submission of the claim to Divisional office. Failure to do so shall result in non-acceptance of invoice/bills by the Divisional office.
- 21. CLARIFICATION:** If any clarification is required by the Firm/contractor in relation of technical specifications, the same shall be had from the office of the Assistant Executive Engineer concerned/ Executive Engineer PHE Mechanical Division South Awantipora before the date of start of work.

(Contd. On page...3rd...)

Executive Engineer

ANNEXURE "A" to this office Allotment Order No: /D of 05/2023

22. **CONSIGNEE/PAYING AUTHORITY:** The consignee/paying authority in respect of electromechanical component and associated civil works shall be the concerned Executive Engineer, Jal Shakti (PHE) Mechanical Division Awantipora. Besides, the supervision of the various components of the civil work shall be carried out by the concerned Division under the overall coordination of the concerned Superintending Engineer Hydraulic Circle.
23. **TERMS OF PAYMENT:** All payments to the contractor for fulfilling the contract will be made as per the unit rates of Price Schedule (BOQ). All payments will be made in Indian Currency and will be subject to deduction of Income tax, GST, Cess at source, on the rates as are in vogue at the time of release of payment:-
- 65% of the contract value shall be paid on receipt of the material at site (as per the BOQ) in full & verification thereof by the concerned Assistant Executive Engineer.
 - 15% of the contract value shall be released on installation of ordered equipment/material in full at site.
 - 10% of the Contract Value shall be released after successful testing and commissioning of the entire equipment on full load, commissioning and trial run.
 - 10% of the Contract Value shall be released after commissioning of the scheme and satisfactory performance of the equipment for the period as enunciated in warranty clause. However the balance amount can be released against furnishing of Bank Guarantee for an equivalent value valid for three months beyond the expiry of the warranty period of the contract.
24. **WARRANTY:-** The Firm/contractor shall be bound for satisfactory performance of equipment/work **12 months** after the successful completion of trial run. If during warranty period, any malfunctioning/defect arises, the firm shall have to rectify the same within a period of ten days of receipt of intimation. In case of any failure on the part of the firm to remove the defect, the Department may get the defects rectified by any other agency and cost thereof shall be recovered from the firm and shall be recommended for further punitive action as governed under the relevant clause of contract including blacklisting.
25. **TRIAL RUN:-** After completion of work, the firm/contractor will have to make a trial run of the scheme for a period of **03 months** during which the manpower required for operation shall be provided by the Department.
26. **EQUIPMENT MAKE:** The supplied material/equipments should confirm as per specification of the contract as well as make confirmed by the Firm/contractor.
27. The work done claim should be supported with Geo tagged photographs before, during and after execution of the job.
28. **SITE OFFICE:** - The Firm/Contractor has to maintain at his own cost a suitable site office at the site of work to which the Department sends communications/instructions.
29. **TRAINING OF DEPARTMENTAL STAFF:** - The bidder shall arrange at his own cost and risk to depute at least one competent Engineer of the equipment manufacturer to train up to twelve departmental representatives in the operation & maintenance of the equipment at site. This training shall be for duration of at least 04 consecutive months and shall commence from the date of successful commissioning of the equipment or as may be mutually agreed upon. To groups of Departmental Engineers shall also be deputed to bidders/manufacturers works for short duration to obtain training free cost in the operation & maintenance of the equipment.
30. **DRAWING & QUALITY ASSURANCE PLAN:** - The Firm/Contractor shall be necessarily furnish within two weeks of the date of placement of this order which shall be approved by the Department within two weeks from the receipt by the consignee:-
- Sectional drawing of pumps.
 - General Arrangement Drawings (GAD)/ layout of the equipment fully dimensioned for pumps, motors, starters, shunt capacitors, panels, delivery manifold, cables etc.
 - Detailed circuit diagrams of LT Panels, Starters, Shunt Capacitors etc.
- Quality assurance plan (QAP) of each piece of equipment to Third Party Inspection Agency (TPA) and Department for their approval.

No manufacturing/fabrication activity shall be started by the Firm without approval of the drawings of each ordered equipment by the competent authority. Additional time consumed due to observations/summary rejection of QAP/GAD shall not be considered in the delivery period of the contract and the bidder shall be wholly and solely held responsible for the delay thus caused.

(Contd. On page...4th ...)

Executive Engineer


ANNEXURE "A" to this office Allotment Order No: 10 of 05/2023

31. INSPECTION & TESTING:- Before dispatch from the works of the OEM, the electro-mechanical equipment shall be inspected by a third party inspection agency i.e. M/5 CEIL/Rites etc. New Delhi. However, the Firm (Bidder) shall make payment to the Inspection Agency (in case of 3rd Party Inspection) which shall subsequently be reimbursed by the Department. The successful tenderer shall intimate the Department and the Inspecting Agency/Authority in advance regarding the readiness of the equipment for dispatch and shall furnish test certificates. It shall be responsibility of the suppliers to tie up with the third party nominated for inspection and get necessary inspection of the material done within the delivery period. Any delay on the part of the third party shall not be entertained as an excuse for timely supply of material. The product/ material at site shall be inspected by Assistant Executive Engineer concerned or any other official(s) of the department designated by the concerned Executive Engineer. Any modifications to the works as specified in the specifications considered to be necessary for smooth and trouble-free operation of the equipment by the Department or the third-party inspection agency, the firm shall have to execute the same without any extra cost, to the best satisfaction of the department. The firm shall as such keep the department informed about arrival of material at site. It shall be obligatory on the part of the firm to rectify the defects pointed out by the AEE, if any, and also to incorporate any modification within the scope of work which may be deemed necessary for better performance/finish and workmanship. The supplier upon demand by the department or its representative shall rectify or replace defective unsuitable equipment. The Department reserves the right to nominate his representative for inspection of the goods at the works of the supplier/ manufacturers. As such the department at all reasonable times shall have access to the works and to the site and to all workshops and places where work is being executed and where material / manufactured articles and machinery are being obtained. In case of Sub-Station and power/feeder lines, the firm shall have to obtain a clearance certificate from the concerned inspection Division of the Power Development Department. The list of electromechanical equipment in which third party inspection from CEIL/RITES is to carried on:-

- 1) DG Set > 100 KVA.
- 2) Pumping Unit > 100 HP (Horizontal and Vertical)
- 3) Valves >300 mm
- 4) Pipe > 200mm dia
- 5) HT Transformers > 300 KVA
- 6) Voltage Stabilizers > 500 KVA
- 7) Iron Removal Plant

For items other than those manufacturers test certificate shall have to be provided. The HT transformers shall have to be got inspected from the corresponding wing of Power Development department and the necessary certificate shall be submitted along with the manufacturers test certificate.

32. The work is executed strictly in close supervision of AEE/JE/Supervisory staff concerned. However, the civil work if involved should be executed under close supervision of civil counterpart.
33. **WATCH & WARD OF WORKS:** The Firm shall in connection with the work provide and maintain at his own cost all lights, guards, fencing and watching, when and where necessary or required by the Department for the protection of the work or safety and convenience of the Public etc.
34. All other terms and conditions shall be the part of this contract as laid down in e-NIT/SBD/GFR-2017/e-procurement manual 2019 and PWD form"25" double.


Executive Engineer
Jal Shakti PHE Mechanical Division
(South) Awantipora
(Member JJM)


Annexure 'B' to this Office Allotment Order No. 10 of 05/2023 for WSS Zodiopora

Sl No	Description of Work / Item(s) with technical specifications	No. of Qty	Units	Alloted/ Accepted Rate	Amount
1.00	(Electro-Mechanical Items) WSS Zodiopora				
2.00	<p>Supply, installation, Testing & Commissioning of 7.5 HP non clog Pumping Unit as per IS 5600 at Raw Water Stage PUMP - 7500GPH at 34M head Type of pump - non-clog Open well Submersible Vertical Pump Solid Handling Capacity 20mm (Minimum) Quality of water - Raw water to be handled • MATERIAL OF CONSTRUCTION: • Pump Casing - Cast Iron • Impeller : Stainless Steel • Pump Shaft - Stainless Steel • Motor Body : Cast Iron/SS • Sealing - Dual mech seal □ The bowl plate shall be provided with name plate depicting all specifications MOTOR - • Type - Squirrel Cage 3-Phase Induction Motor • Method of starting - Star - Delta/DOL (as specified). • Frequency : 50Hz + 3% • Voltage : 415 ± 6 %, - 15% 3 phase • Class of insulation - Suitable for above rating. • Sealing - Dual mech seal. Provided with thermal and overload protection The motor shall be made of corrosion resisting materials to resist corrosion under normal conditions and the motor shall have a name plate depicting all specifications Dual Mechanical Seals (01 No) and Bearings (02 No) for the pumping unit must be provided as spare parts for preventive maintenance by the firm. for each pumping unit. Note: Test certificate having the Serial No. of the Pumping Unit along with the performance curve in duplicate from the Manufacturer must be produced on delivery of the item and pumping unit is to be approved from the concerned Sub Divisional office before procuring. (Make: KSB/Kirloskar/Wilo)</p>	2.00	Job	61740.00	123480.00
3.00	<p>Supply, installation, testing and commissioning of 15HP Horizontal pumping unit as per IS 1520 with following specification:- Pump - 7000 GPH at 65 Mtr head. Supply, installation, testing and commissioning of Horizontal pumping unit as per IS 1520 with following specification:- 1.Type :- Horizontal split casing /Single stage Material of construction: 1.Impeller:- Stainless steel 2.Shaft- SS410 3.Pump casing - Cast Iron The pump shall confirm to IS-1520 code MOTOR :- A) Type :- Horizontal squirrel cage Induction Type B) No of phases: 3 phase 415 V+10%,50 Hz, AC supply C) Winding:-Copper wound squirrel cage D) Type of enclosure - SPDP/TEFC E) Method of cooling:- Air cooled with fan mounted F) Method of Starting: star delta The pump-motor should be mounted on a common base frame fabricated out of M.S channel of suitable size and duly fitted with T- type foundation bolts /nuts and washers to make the pumping unit vibration free. The pump and motor should be coupled through suitable coupling. The coupling faces checked for both angular and axial alignment with the help of tapered gauges/feeler gauges or dial indicator. Job includes testing and commissioning of pumping unit on full load at site. Note: Test certificate having the Serial No. of the Pumping Unit along with the performance curve in duplicate from the Manufacturer must be produced on delivery of the item and pumping unit is to be approved from the concerned Sub Divisional office before procuring. (Make: KSB/Kirloskar/Wilo)</p>	2.00	Job	154350.00	308700.00
4.00	<p>Providing and fitting of Ductile Iron double flanged, Slanted seat swing check valve (NRV) as per IS 5312. The body shall be of ductile cast iron with fully encapsulated vulcanized EPDM rubber (Approved for drinking water). The valve shall be compatible for buried applications and shall be safe to install in both horizontal and vertical positions. It shall have electrostatic epoxy coating (approved for drinking water) both inside and outside of the valve. Cost on account of Nuts, bolts, gaskets, etc required for the job is included in the scope of work. The job includes providing and fitting of 02 nos. M.S flanges (Table flanges) perfectly adaptable to the inbuilt flanges of the valve which shall be fitted with Rising main of the pumping unit at appropriate spots as per site requirement. The job includes the cost on account of P/F of nuts, bolts and gasket required for the job. Size: 80mm PN: 1.6/16 (Make: Sigma Flow/Tallis/VAG/Sachdeva)</p>	2.00	Job	16980.00	33960.00
4.01	Size: 100mm PN: 1.6/16 (Make: Sigma Flow/Tallis/VAG/Sachdeva)	1.00	Job	19982.00	19982.00


 Executive Engineer


Annexure 'B' to this Office Allotment Order No. 10 of 05/2023 for WSS Zodipora

Sl.No	Description of Work / Item(s) with technical specifications	No. of Qty	Units	Alloted/ Accepted Rate	Amount
5 00	Providing and fitting of Ductile Iron double flanged, non-rising spindle soft seated glandless gate/ sluice valves as per IS14846 for regulating the water supply outside the pumping units The body and bonnet of the valve shall be of ductile iron, wedge with fully vulcanized EPDM rubber (Approved for drinking water) and NBR seal. The Gate/Sluice valve shall be compatible for buried applications and shall be safe to install in both horizontal and vertical positions It shall have electrostatic epoxy coating (approved for drinking water) both inside and outside of the valve The valve shall be supplied along with hand wheel Cost on account of Nuts, bolts, gaskets, etc required for the job is included in the scope of work The job includes providing and fitting of 02 nos. M S flanges (Table flanges) perfectly adaptable to the inbuilt flanges of the valve which shall be fitted with rising main of the pumping unit at appropriate spots as per site requirement. The job includes the cost on account of P/F of nuts, bolts and gasket required for the job Size DN80 PN 16/16 (Make: Sigma Flow/Tallis/Sachdeva)	1 00	Job	15045.00	15045.00
5 01	Size DN100 PN 16/16 (Make: Sigma Flow/Tallis/Sachdeva)	1.00	Job	18538.00	18538.00
6 00	Fabrication, Providing and fitting of Y- junction having 1m length (Approx.) of each arm to be fabricated out of hot dip galvanized G I, C-Class pipe. The job also includes Providing and welding of M S flanges to the ends of each arm. The Thickness of flange shall conform to IS 6392 Part 1st Table-17. The flange welding shall be carried out in double layers using reputed make electrodes to form strong welding joint by dint of DC arc welding. The job further includes Providing and Fitting of nuts and bolts (conforming to IS:1363 Part 1st) and Rubber Insertion Gaskets (conforming to IS: 638/79) to be used between flanged joints. The size of the Y- junction is given below: 80 mm	1.00	Job	6343.00	6343.00
7.00	Fabrication, Providing and fitting of MUG-20 Modular motor control panel of appropriate size fabricated out of 14 SWG sheet having required openings/vents and protection Class : IP-55 & fitted with accessories as under: a) Bus bar Chamber: The bus bar chamber shall be fitted at the top of the panel horizontally throughout the length. There shall be 3 Nos. of phase bus bar and 1 No neutral bus bar and 1 No earthing bus bar. The bus bars shall be air insulated and made-up of high conductivity COPPER with current density of suitable rating for 100/200 Ampere. All panel compartments shall be provided with suitable cable alley and vertical bus bar alley. Suitable segregation shall be provided in between bus bar chamber and adjoining compartments. The bus bar shall be PVC sleeved with color strips of red, yellow, blue and black and the same be arranged in accordance with IS-375 specs. Electrical clearances shall be maintained between phases, neutral and body as per standards. b) Main Circuit Breaker (Incomer MCCB): Qty. = 02 No. of poles = 4 Pole Current Rating = 100 Amp. Rated operational voltage = 415 V + 15 % Rated frequency = 50+/-3%Hz Ambient temperature = 40C Ultimate S.C Breaking Cap. at (415V AC, 50 Hz) = As per requirement Type of release = Thermal-Magnetic Overload protection = 0.8 - 1xIn adjustable Short-circuit protection = 6-10xIn adjustable. Current rating = 100 Amp c) Change over Switch: Qty. = 01 No. Rating = As per requirement Type = Front operated, on load, 4 pole, 400 +15%V, 50 + 3%Hz. d) Motor Back-up Protection MCCB: Qty = 2 No No. of poles = 3P Current Rating = As per requirement Rated operational voltage = 415 V +15 % Rated frequency = 50 + 3% Hz Ambient temperature = 40C Ultimate S.C Breaking Cap. at (415V AC, 50 Hz) = As per requirement current rating = 200 A e. Submersible starters:- Fully automatic star delta/DOL starters. Capacity = 20 HP Power Specs = 3 Φ, 415 + 15% V, 50 + 3 % Hz. Relay range = 20-32 A. Coil Voltage = 380 v	1.00	Job	174612.00	174612.00


 Executive Engineer

Annexure 'B' to this Office Allotment Order No. / 0 of 05/2023 for WSS Zodipora

Sl.No	Description of Work / Item(s) with technical specifications	No. of Qty	Units	Alloted/ Accepted Rate	Amount
	<p>Protection = single phasing phase Reversal phase unbalance (55 ± 5 V) Rated insulation voltage = 690V Terminal capacity = 120 Sq. mm with lug Or above Conformity to standard = (IS/IEC 60947-4-1 Qty = 2 Nos e) Auxiliary MCCB for Heating/Lighting Circuit Breaker = MCCB (Outgoing) Qty = 1 No No. of poles = 4P Current Rating= 63 Amp. Rated operational voltage = 415 V + 15 % Ultimate S C Breaking Cap at (415V AC, 50 Hz) = As per requirement g) Motor Protection Relay Digital Motor Protection Relay with LCD Display for 3-phase supply with following protections suitable for the Modular Control Panel: Protections = Thermal Overload with pre-alarm, Short Circuit, Phase Loss, Unbalance, Phase reversal, Under Current, over current, Prolong starting, Locked Rotor, Under voltage, over voltage & Earth fault h. M-power module for mobile starter for submersible motor 1P/3P 3 wire (VRS Languages – English, Hind, Suitable Region- North India i) The panel shall be provided with phase indicators (03 NO) and digital ammeter of range 0-60 A, digital voltmeter of range 0-500 V and digital frequency meter (01 No for each starter). The enclosure of the panel shall be of excellent fit and finish, corrosion resistant and powder coated gliding hinges for smooth and noiseless movement of windows and advanced locking arrangements. MUG 20 Modular Panel Details/Description item wise i) Bus bar size: 10 mtr x 02 mtr x 0.003 mtr x)8960 kg/m³ = 5.38 kgs @ 1000/100A ii) D-sine MCCB 4 pole (DZ1 160N, 108-160, 50KA) iii) Change over switch 100A iv) D sine MCCB 3 pole DN0 100D, 80-100, 36KA) v) Mug x 2 (Mug20 20-32A Relay) vi) Auxiliary MCCB 63Amp 4 Pole vii) MM 10 of L@T (Motor Protection) viii) Module for mobile starter ix) Meter (Ammeter & voltmeter) 2No. each and Freq Meter x) Indicators LS xi) Over load and Under Voltage Minilec (Change Over & MCCB Make: L&T/Havells)</p>				
8.00	Supply installation testing and commissioning of MU-G 15 start delta starter with relay range 11-18 Amp	1.00	No.	15000.00	15000.00
9.00	<p>Providing, fixing, testing and commissioning of 50 KVA voltage stabilizer as per specifications below: Type of voltage controller Manually operated copper wound, 3-phase, AC power supply multi step. Type of Regulator : Double plate type with electrolytic copper contacts. Input voltage : 250-400 volts. (3 phase) Output voltage : 400 ±10% volts. Frequency : 50 ±3 C/S. Windings : Electrolytic grade copper of adequate section, vacuum impregnated and Oven-dried. Insulation : Fiber glass insulations to tested parameters. Cooling : Naturally, Oil cooled Temp. Rise (Max) : 30°C above ambient Mounting : On Uni-directional wheels. Correction rate : 30 volts per step Wave form distortion : virtually nil Duty cycle : 100% continuous Enclosure : MS sheet enclosure in pressed CGR Sheet powder coated with radiators. Core laminates : High grade, low eddy loss, grain oriented silicon steel laminations. Load : Three phase induction motor load. Load Amperes (continuous) Overload in 24-hours operation: 10% above continuous Ampere rating. The voltage stabilizer shall have T-oil level indicator gauge preferably glass type tube or otherwise visible to naked eye. The top of the container to have a display panel for housing 02 numbers Digital voltmeters (0-500V) along with 4-way selector switch and set of neon indicators for incoming and outgoing phases (06 No's). Insulating media (T. Oil) of 11 KVA grade to be provided and filled up to top level, with dielectric strength of 5 KV at 4m air gap. The T-Oil of specific grade should be provided in separate barrels and filled at site up to top level. The voltage Stabilizer shall be accepted with manufacturers dully stamped test certificate and shall have name plate with specifications.</p>	1.00	Job	97637.00	97637.00
10.00	Removal of choked filter media from 5000/ 6000 GPH pressure filter vessel. The job includes all loads and lifts, disposal of choked media to dumping site outside the premises of the plant within a lead of 5 km. The vessel needs to be cleaned properly and dried before laying of fresh media.	1.00	Job	7000.00	7000.00
11.00	Providing and laying of filter media of specific size and grade (preferably from sindh Nallah Ganderbal) to be laid in 5000/6000 GPH Pressure vessel duly washed, free from dust, dirt, loom and any other inorganic material or suspension. the job includes carriage of filter media from Ganderbal to site including all all loads and lifts required on the site condition. The media is to be lad in different layers of specific size and grade from bottom to top over the filter bed plate. The bottom layer is to be laid without tilling/damaging the pressure nozzles	1.00	Job	14994.00	14994.00
12.00	Providing and fitting of 12 mm dia. Fine threaded PVC nozzles auxiliary type to be fitted on filter bed plate of pressure vessel.	550.00	Job	290.00	159500.00

Executive Engineer

Annexure 'B' to this Office Allotment Order No. 10 of 05/2023 for WSS Zodipora

Sl.No	Description of Work / Item(s) with technical specifications	No. of Qty	Units	Allotted/ Accepted Rate	Amount
13.00	Providing and fitting of 29 inch dia rubber washers /gaskets for manhole and inspection chamber and opening of pressure filter vessel	2.00	Job	1500.00	3000.00
14.00	Providing and fitting of 3"x5/8" nuts and bolts	15.00	Kg	118.00	1770.00
15.00	Painting with synthetic enamel paint two or more coats of approved brand and bor pressure clarifier pressure filter vessel, fittings and complete piping after cleaning of dirt by kerosene oil and application of steel primer of specific grade	1.00	Job	5292.00	5292.00
16.00	P/A/T/C of horizontal monoblock pumping equipment of following parameters: a) Discharge - 6000 GPH, b) Head - 30 meters, c) Speed - 1440 rpm The pump & motor should be mounted on a suitable size MS base frame. The Job also includes P/F of foundation bolts. Motor rating not less than 5 HP (Make: Kirloskar/KSB/Wilo/M&P)	1.00	Job	48534.00	48534.00
17.00	P/A/T/C of backwash pumping equipment of following parameters Discharge-16 lps HP-5, Head range 6-15mtr (Make: Kirloskar/KSB/Wilo/M&P)	1.00	Job	29400.00	29400.00
18.00	P/A/T/C of air scavenging/blower unit of following parameters Capacity: -50 CFM, Pressure: -5 PS 10, Speed - 1450 RPM Motor as per requirement	1.00	Job	220500.00	220500.00
19.00	Providing fabrication and fitting of welded MS wire mesh (0.50 sq inch and 1.40mm wire dia for Bird screening to the CGI Pressure Filter House	400.00	Sft	37.00	14800.00
20.00	Replacement of 25 mm dia -03 nos (Ball Valves-Reputed make) The job includes providing and fitting of nuts and bolts and washers with allied mechanical works. The job includes Providing, fitting of 25mm dia GI-6 mtrs with necessary fittings as per requirement.	3.00	Job	6000.00	18000.00
21.00	Replacement of 80 mm dia DI gate valves	3.00	Job	4000.00	12000.00
22.00	Replacement of 65 mm Butterfly valves	1.00	Job	3000.00	3000.00
23.00	P/A/T/C of 5 HP DOL	3.00	Job	3000.00	9000.00
24.00	Providing, fitting and testing of 25 mm gate valve. The job includes Providing, fitting of 25mm dia GI-6 mtrs with necessary fittings as per requirement.	1.00	Job	2000.00	2000.00
25.00	Replacement of 80 mm dia cast iron diaphragm valves by way of including fresh DI gate /Butterfly valves with pressure rating of PN16	4.00	Job	4000.00	16000.00
26.00	P/F/Welding of 80 mm flanges to the existing piping system	8.00	Job	750.00	6000.00
27.00	Providing and fitting of Ductile Iron double flanged, Slanted seat swing check valve (NRV) as per IS 5312. The body shall be of ductile cast iron with fully encapsulated vulcanized EPDM rubber (Approved for drinking water). The valve shall be compatible for buried applications and shall be safe to install in both horizontal and vertical positions. It shall have electrostatic epoxy coating (approved for drinking water) both inside and outside of the valve. Cost on account of Nuts, bolts, gaskets, etc required for the job is included in the scope of work. The job includes providing and fitting of 02 nos. M.S flanges (Table flanges) perfectly adaptable to the inbuilt flanges of the valve which shall be fitted with Rising main of the pumping unit at appropriate spots as per site requirement. The job includes the cost on account of P/F of nuts, bolts and gasket required for the job. Size: 50mm PN: 1.6/16 (Make: Sigma Flow/Tallis/Sachdeva)	2.00	Job	12529.00	25058.00
28.00	P/F/Welding of 50 mm flanges to the existing piping system after cutting the damaged ones.	2.00	Job	500.00	1000.00
29.00	Replacement of agitator in alum solution holding tank fabricated out of wetted parts in stainless speed 20-30 intermediate bearing type twin blades free standing type	1.00	Job	17640.00	17640.00
30.00	Providing & Fitting of Dozing pumps to doze required quantity of alum/Chlorine in the system. The capacity of the dozing units shall be 12-20 LPH capacity Dozing pups shall be provided with all required accessories including 200 ltrs PVC tank and cable for connection. Each pump shall be provided with 20 mtrs. Cable as per required specification.	1.00	Job	15000.00	15000.00
31.00	Providing and fitting of pressure gauges with adopters to replace damaged ones these pressure gauges should be in the range of 0-50 kgf/cm ² and be reputed make.	3.00	Job	8232.00	24696.00
32.00	Providing & Fitting of lighting points in 1.5 mm Sq. multi strand PVC wire as conductor to be laid carried in PVC channel /conduit as per site requirement. The Job also includes Providing and fitting of 5 Amp. Switch Button /angle holders to be fitted with 15 watt LED inside the Pump house.	6.00	Job	1200.00	7200.00
33.00	Providing & fitting of heating points in 2.5 sq. multi strand conductor to be laid & carried in PVC channel/Conduit as per site requirement. The job includes providing and fitting of 16 Amp. Switch socket combine	3.00	Job	1500.00	4500.00
34.00	Supply, installation, erection of 9 mtrs long ST- 410 (sp-33). The job further includes drilling of holes for installation of various accessories wherever required. The job further includes GI wire earthing of pole as per REC standard.	2.00	No	20083.00	40166.00
35.00	Providing and fitting GI Channel /Angle/ Flat of sizes including clamps	100.00	Kg	123.00	12300.00
36.00	Supply, Installation, Testing and commissioning of Polymeric Gang operated Air break switch, outdoor type, triple pole, suitable for vertical installation, single break provided with locking arrangement at both ON and OFF position consisting of HT post double insulator, copper or copper alloy high pressure heavy contact assembly, rod with bearings, operating handle and 2 length of 32mm dia. GI pipe conforming to IS 1818 1961, 06 No. of insulators, rated voltage 11KV 200A complete as per IS specs.	1.00	Job	11388.00	11388.00
37.00	Supply, Installation, Testing and commissioning of 11KV polymer fuses Set Horn Gap 3-phase 200 A suitable for vertical installation.	1.00	Job	4838.00	4838.00

Executive Engineer

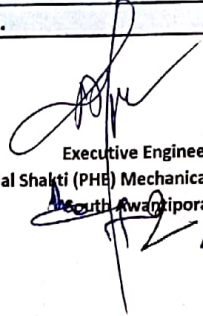
Annexure 'B' to this Office Allotment Order No. 10 of 05/2023 for WSS Zodipora

Sl.No	Description of Work / Item(s) with technical specifications	No. of Qty	Units	Alloted/ Accepted Rate	Amount
38.00	Supply, installation, Testing and commissioning of Gapless Surge arrester station class, 10KA, 9KV, LA With polymer housing, Station Type				
39.00	Supply and fitting of 11 KV polymeric composite pin insulator 12 KV, 5KN, Lighting impulse 75KV Positive, and 80 KV Negative, creepage distance 320 mm	1.00	Set	7528.00	7528.00
40.00	Providing and fitting of ACSR as per IS 398 (part-2) 1996 for 50 sq mm ACSR (Galvanised steel reinforced) for fitment of various accessories	6.00	Job	337.00	2022.00
41.00	Painting of poles Red oxide	40.00	Mtr	55.00	2200.00
42.00	Painting of poles Aluminum paint	2.00	Lit	297.00	594.00
43.00	P/F of Galvanized nuts, bolts of various sizes as per site requirement	2.00	Lit	495.00	990.00
		4.00	Kg	138.00	552.00
44.00	P/F of earthing station for substation, LT panel, and stabilizer comprising of company fabricated earthing electrode as per IS 3043. The job includes Auguring of bore of required dia/depth for installation of electrode along with backfill compound mixed with soil and all other items required thereof for achieving the best result. The job includes connecting of electric gadgets through GI strip as per relevant standards. Safe earthing electrode size : 80 mm dia, Length : 2000 mm Back fill compound : 30 kg	4.00	No	10462.00	41848.00
45.00	Illumination of Premises Providing and erection of 9 Mtr long Hot Dip Galvanized octagonal pole (single Section) with bottom 150mm, top 75mm wide, thickness 3mm with 70 Microns Zinc coating having inside arrangement for providing of power connection along with following items. 1) 3 Way Terminal Connector 20 Amp. 2) 3 No MCB 6 Amp The job includes fabrication, providing and fitting of three arm GI structure at the top having 120° angle between arms and each arm having 15° inclination with respect to horizontal plane. Each arm should be of 2' length and size and shape appropriate as per requirement of the luminary. The job also includes providing and fitting of required length of flexible multistrand 2 mm copper wire from each terminal connector to each holding arm. The pole is mounted on 1:2:4 Cement concreting of size not less than 2'x2'x6" (cost of concreting not included in the job) using 04 No anchor bolts of required size not less than 7" in length. The complete job includes earthing in GI Electrode as per relevant IS Code	2.00	Job	21168.00	42336.00
46.00	Providing, installation, testing and commissioning of area lighting 120 Watt LED (Street Light Type) on top of octagonal pole. (Make: Havells/Philips) Having following specs: Input: 90-240 V 50 Hz Power Factor: >0.9 Colour Temperature: 4K - 6.5K Beam Angle: 120° - 170° Lumens: >12000 Operating Temperature: -20°C to 60°C The LED is pressure die cast aluminum housing with power coated finish and having Ingress Protection up to IP-68. The LED is properly fitted on the arm of the pole and connected to the copper wire as provided in the high mast pole	4.00	Job	8500.00	34000.00
47.00	Providing, Installation and testing of 2KVA fully automatic voltage stabilizer with input voltage 70-240 V and output 220 V. The stabilizer shall be installed and connected to the electric circuit as per location provided by site incharge.	1.00	Job	7500.00	7500.00
48.00	Supply, Installation and Testing of 35 Sq mm XLPE Aluminum H.T cable (ABC type) of 11 KV grade with following specs. Size (cross sectional area in sq mm) = 3x35 with reinforced wire Phases: Red, Yellow, Blue. (Make: Finolex/Gloster/Havells)	150.00	Mtr	794.00	119100.00
49.00	P/F of 11 KV cable termination kit for connecting 35 Sq mm XLPE cable (ABC type) with the existing HT line near tapping point and 100 KVA HT transformer.	2.00	Job	8500.00	17000.00
50.00	Providing and Fitting of 3.5/2-Core, XLPE Armoured Aluminium Cable conforming to IS: 7089 part 1st as service line from the HT transformer to control panel including necessary thimbling, crimping, taping etc. NOTE:- The cable terminal ends for connection to switchgear at various requisite points shall be Al. Thimbles of dowel's make and of appropriate size and connected by hydraulic crimp tool only. i) 50 sqmm, 3.5core (Make: Finolex/Gloster/Havells)	50.00	Mtr	473.00	23650.00
50.01	ii) 10 sqmm, 2 core (Make: Finolex/Gloster/Havells)	90.00	Mtr	154.00	13860.00
51.00	Providing and Fitting of single-Core, copper pvc insulated Cable, XLPE armoured conforming to IS: 7089 part 1st for intermal connections crimping, taping etc. NOTE:- The cable terminal ends for connection to switchgear at various requisite points shall be Al. Thimbles and of appropriate size and connected by hydraulic crimp tool only. Single core PVC insulated 25sqmm (Make: Finolex/Gloster/Havells)	90.00	Mtr	365.00	32850.00
52.00	Providing and fitting of 3-Core flat submersible copper cable conforming to IS: 694 (Part 1st) - 1964 & IS: 694 (Part 2nd) - 1964 for Submersible Pumping Unit and other electrical Equipments. The cable connections terminal shall be fitted with copper thimbles of required size. Size: 10 sq.mm (Make: Finolex/Gloster/Havells)	180.00	Mtr	454.00	81720.00
53.00	Fabrication of gantry mechanism by way of providing Structural steel in built up sections, trusses and framed work, including cutting, hoisting, fixing in position and applying a priming coat of approved steel primer all complete welded. The drawings and Dimensions for Gantry/CGI Shed will be provided by Site In Charge at the time of execution of job.	600.00	Kg	102.00	61200.00

Executive Engineer

Annexure 'B' to this Office Allotment Order No. 10 of 05/2023 for WSS Zodipora

Sl.No	Description of Work / Item(s) with technical specifications	No. of Qty	Units	Alloted/ Accepted Rate	Amount
54.00	<p>Providing, installation and testing of manual type triple spur gear chain pulley block along with monorail geared travelling trolley having following features Gears - The hoist shall have precision machine case Hardened alloy steel gear mounted on bearings and housed in a dust proof gear box. The lubrication of gears should be of high viscosity and temperature for longer life of gears.</p> <p>Load Chain - The load chain be made of high tensile alloy steel having wear resistance and greatest mobility. The chain should be accurately collaborated, tested and have adequate in built factor of safety for safer operation.</p> <p>Load chain wheel - the load chain well should be double ball bearing supported and Specially designed, perfectly machined wheel providing correct grip of load chain to makes the hoist most safe and reliable against any failure. The main specifications of C.P Block are given below :</p> <p>Make = Pull Lift/Globe Capacity = 2 ton No. Of load chain falls = 2 or above Min. Height of lift = 6 M</p>	1.00	Job	44473.00	44473.00
Total in Figures:					2081296.000
Say Rs.					2081000.000
Total in Words: Rupees Twenty Lac & Eighty-One Thousand only.					


 Executive Engineer
 Jal Shakti (PHE) Mechanical Division
 South Awantipora

Executive Engineer